


PLAN VIEW

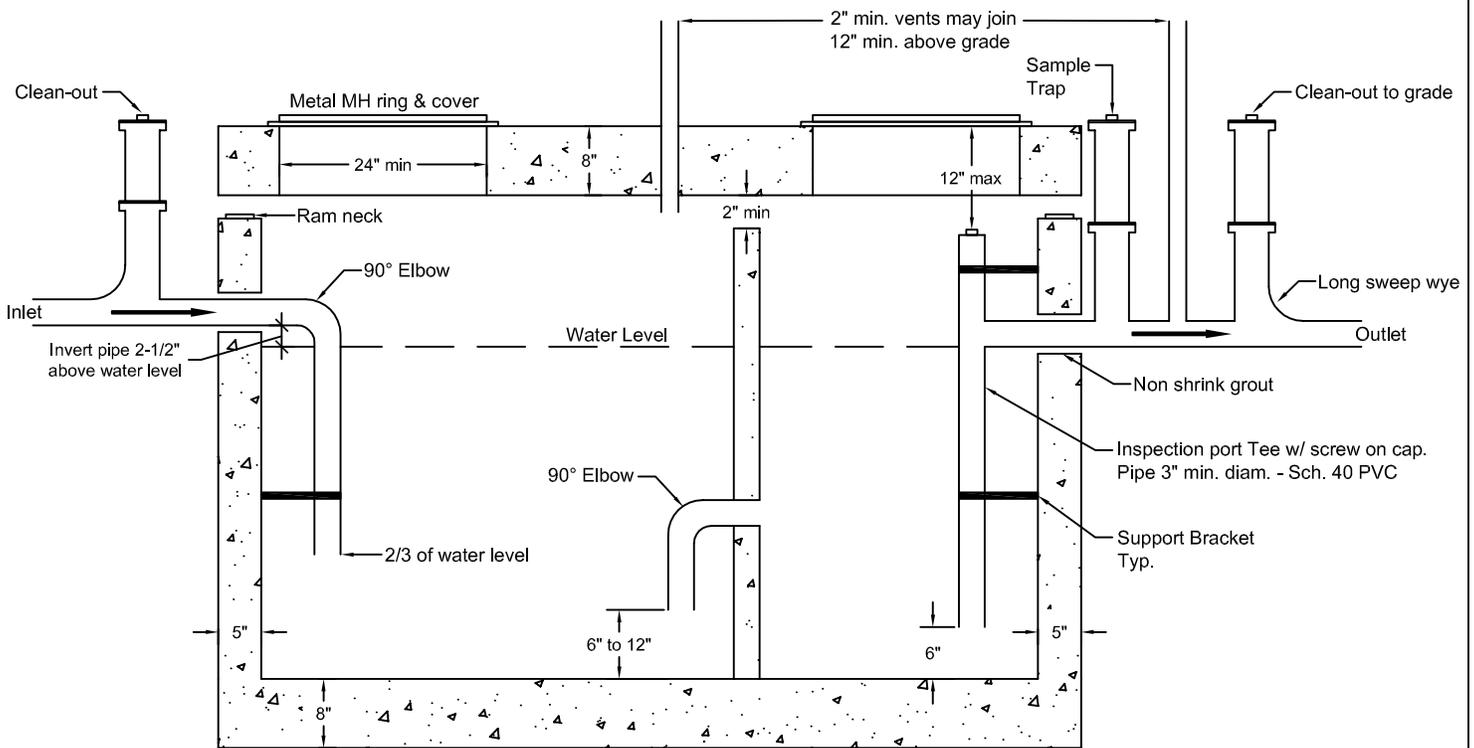

SECTION VIEW

General Notes:

1. These details are only intended to show standard requirements for grease interceptors.
2. All pipe and fittings must be approved soil pipe, 3" min diameter, Sch. 40 PVC.
3. Outlet pipe invert must be 2-1/2" lower than inlet.
4. Support brackets and clean-out plugs must be brass.
5. Vent pipes may be joined 12" above grade minimum.
6. No more than 2 manhole ring risers stack on each other without authorization.
7. Utilities Department must approve bolt down manhole covers.



TITLE : GREASE INTERCEPTOR 1000 GALLONS	
DETAIL DRAWING NUMBER : 333-21	
APPROVED BY : DENNIS CROCK	DATE: OCT 30, 2012